


Deep Rib IV




INDUSTRIAL-COMMERCIAL ROOFING & SIDING

Effective September 2007

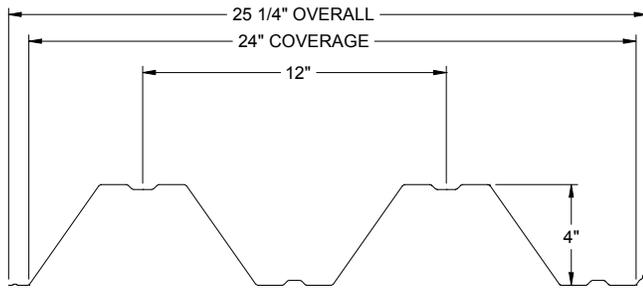

SIDING

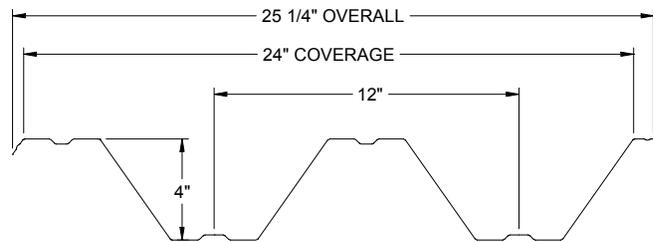

ROOFING

MATERIAL AND THICKNESS	WT./SQ. PLAIN	WT./SQ. PAINTED	METAL SPECIFICATION	FINISH
GALVANIZED STEEL 22 ga. 20 ga. 18 ga.	189.3 lb. 223.0 lb. 290.0 lb.	191.1 lb. 224.8 lb. 292.1 lb.	Grade 50 (50 ksi yield strength) (18ga grade 40-40 ksi yield strength) with G90 coating, both conforming to ASTM A 653	plain: regular spangle Painted: two-coat 70% Kynar® 500/Hylar® 5000; siliconized polyester; vinyl plastisol; 0.5 mil two-coat polyester backer
ALUMINUM-ZINC ALLOY COATED STEEL 22 ga. 20 ga. 18 ga.	184.4 lb. 218.2 lb. 285.7 lb.	186.2 lb. 219.9 lb. 287.5 lb.	Grade 50 (50 ksi yield strength) (18ga grade 40-40 ksi yield strength) structural steel with AZ50 coating, both conforming to ASTM A 792	plain: regular spangle Painted: two-coat 70% Kynar® 500/Hylar® 5000; siliconized polyester; vinyl plastisol; 0.5 mil two-coat polyester backer
ALUMINUM .032" .040" .050"	60.8 lb. 76.0 lb. 95.0 lb.	62.1 lb. 77.3 lb. 96.4 lb.	3004-H36 or equivalent (28 ksi yield strength) aluminum alloy conforming to ASTM B 209	plain: mill finish Painted: two-coat 70% Kynar® 500/Hylar® 5000; siliconized polyester; vinyl plastisol; 0.5 mil two-coat polyester backer

GRAVITY LOAD TABLE (STEEL) (psf)

ga.	span s	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
22	1	107	88	74	63	55	48	42
	2	100	82	69	59	51	44	39
	3	125	103	94	74	64	55	49
20	1	121	100	91	77	62	54	47
	2	117	96	88	75	60	52	46
	3	146	121	110	93	74	65	57
18	1	147	121	102	87	75	65	57
	2	146	121	101	86	74	65	57
	3	182	151	127	108	93	81	67

GRAVITY LOAD TABLE (ALUMINUM) (psf)

thk.	span s	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"
.032"	1	153	98	68	50	38	30	25
	2	174	111	77	57	43	34	28
	3	217	139	97	71	54	43	35
.040"	1	238	152	106	78	60	47	38
	2	272	215	121	89	68	54	44
	3	340	269	151	111	75	67	54
.050"	1	372	238	165	122	93	74	60
	2	421	269	187	137	105	83	67
	3	526	336	234	172	131	104	84

NOTES:

1. The allowable loads are based on 1986 AISI and 1986 Aluminum Association specifications.
2. The allowable loads are based on stress only.
3. The use of Deep Rib IV on roof pitches less than 1:12 (5°) is not recommended.
4. The maximum recommended individual roof panel length is 16' for aluminum panels and 32' for steel panels due to thermal movement considerations.

Jackson, GA (800) 884-4484
 Grapevine, TX (800) 477-9066
 Salem, OR (800) 477-8028
 Headquarters - Lancaster, PA (800) 477-2741

DEEP RIB IV SPECIFICATIONS

1.01 SUMMARY

- A. Section includes: all material, labor, and equipment to complete installation of Deep Rib IV roofing and siding as shown on the drawings and herein specified. Include all copings, gutters, and flashings contiguous with the panels.
- B. Related Sections
 1. Metal decking
 2. Rough carpentry, plywood, and underlayment
 3. Insulation
 4. Membrane roofing
 5. Flashing and sheet metal
 6. Joint sealers: sealants and caulk
 7. Structural framing.

1.02 REFERENCES

- A. American Society for Testing and Materials (ASTM)
 1. ASTM A 653: Steel Sheet, Zinc-Coated by the Hot Dip Process
 2. ASTM A 792: Steel Sheet, Aluminum-Zinc Alloy Coated by the Hot Dip Process.
 3. ASTM B 209: Aluminum and Aluminum Alloy Sheet and Plate.
- B. Sheet Metal and Air Condition Contractors National Association, Inc. (SMACNA)
 1. SMACNA Architectural Sheet Metal Manual, 1993 Edition.
- C. American Iron and Steel Institute (AISI)
 1. AISI Cold Formed Steel Design Manual
- D. Aluminum Association
 1. Aluminum Design Manual
- E. Metal Construction Association (MCA)
 1. Preformed Metal Wall Guidelines
- F. Code references
 1. ASCE, Minimum Loads for Buildings and Other Structures
 2. BOCA National Building Code
 3. UBC Uniform Building Code
 4. SBC Standard Building Code

1.03 SYSTEM DESCRIPTION

- A. Performance Requirements: Provide factory formed, prefinished, lappable, exposed fastener, structural ribbed metal roof and wall system, that has been pretested and certified by manufacturer to comply with specified requirements under installed conditions.
 1. The metal roofing/siding system including required trim members shall meet the specified requirements for snow loads and wind loads.
 2. The panel will have 4" high ribs at 12" o.c. The width of the crests shall be 3 3/4" and the width of the valleys shall be 3" for siding. The width of the crests shall be 3" and the width of the valleys shall be 3 3/4" for roofing. There shall be one trapezoidal stiffener in each valley and crest.
- B. Structural Requirements: Engineer panels for structural properties in accordance with latest edition of American Iron and Steel Institute's *Cold Formed Steel Design Manual* using "effective width" concept and Aluminum Association's *Aluminum Design Manual*.

1.04 SUBMITTALS

- A. Product Data: submit manufacturer's specifications, standard profile sheet, product data brochure and finish warranty.
- B. Shop Drawings: shop drawings showing roof plan and wall elevations with layout of panels, screws, underlayment and sections of each flashing/trim condition shall be submitted for approval prior to fabrication. Drawings shall contain material type, metal thickness and finish. Drawings shall distinguish between factory and field fabrication.
- C. Samples:
 1. Submit sample 12" long x full width panel, showing proposed metal gauge, panel profile and specified finish.
 2. Submit manufacturers standard colors for Architect's selection.
- D. Certification: Submit manufacturer's certification that materials and finishes meet specification requirements.

1.05 QUALITY ASSURANCE

- A. Panel manufacturer shall have a minimum of ten (10) years of experience in manufacturing exposed fastener roofing and siding panels in a permanent stationary indoor facility.
- B. Panel installer shall have a minimum of two (2) years experience in the installation of exposed fastener roofing and siding and show evidence of successful completion of at least three (3) projects of similar size, scope, and complexity.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Panels and flashings shall be protected and properly packaged to protect against transportation damage in transit to the jobsite.
- B. Upon delivery, exercise care in unloading, stacking, moving, storing, and erecting panels and flashings to prevent twisting, bending, scratching, or denting.
- C. Store panels and flashings in a safe, dry environment under a waterproof covering to prevent water damage. Allow for adequate ventilation to prevent condensation. Panels and flashings with strippable film shall not be stored in direct sunlight.
- D. Upon installation immediately remove strippable film from panels and flashings. Protect panels and flashings from foot traffic and from all other trades.

1.07 PROJECT CONDITIONS

- A. Field dimensions shall be taken prior to fabrication to verify jobsite conditions.
- B. Minimum recommended pitch for this panel is 1:12.
- C. Maximum panel length is 45' (contact the factory for longer panels).

1.08 WARRANTIES

- A. Panel manufacturer shall provide a twenty (20) year warranty on the paint finish covering chalking, cracking, checking, chipping, blistering, peeling, flaking, and fading.
- B. Applicator shall furnish written warranty for a two (2) year period from date of substantial completion of building covering repairs required to maintain roof and flashings in watertight conditions.

2.01 PRODUCT DESCRIPTION

- A. Deep Rib IV structural exposed fastener roof and wall system as manufactured by Fabral, 3449 Hempland Road, Lancaster, PA 17601; ph.: 717-397-2741; fax: 717-397-1040.
- B. The Deep Rib IV panel shall have a coverage of 24". Rib height shall be 4".
- C. Panels shall be directly fastened to the substrate.
- D. The panel shall have a overlapping sidelap feature.

2.02 PRODUCT SUBSTITUTIONS

- A. Requests to use alternate systems shall be submitted in writing to the project designer at least ten (10) days prior to bid date. Request shall demonstrate proposed substitution meets or exceeds specified performance requirements. Certified statements, samples and descriptive data shall be included in this submittal request.
- B. Manufacturers listed in this section are prequalified manufacturers. Substitution of manufacturer's products for those specified shall not be allowed at anytime during construction.

2.03 MATERIALS AND FINISHES

- A. Panel materials
 1. 22, 20 Grade 50 (50 ksi yield strength); or 18 gauge Grade 40 (40 ksi yield strength) structural steel with G90 (0.90 oz./ft.²) hot dipped galvanized coating, both conforming to ASTM A 653.
 2. 22, 20 Grade 50 (50 ksi yield strength); or 18 gauge Grade 40 (40 ksi yield strength) structural steel with AZ50 (0.50 oz./ft.²) aluminum-zinc alloy coating, both conforming to ASTM A 792.
 3. 0.032, 0.040, or 0.050", 3004-H36 or equivalent (28 ksi yield strength) aluminum alloy conforming to ASTM B 209.
- B. Texture: panels shall be smooth.
- C. Refer to manufacturer's standard color card to determine appropriate finish and color. All panels shall receive a factory-applied (siliconized polyester) (Kynar® 500 or Hylar® 5000*) (vinyl plastisol) conforming to the following:
 1. Metal preparation: all metal shall have the surfaces carefully prepared for painting on a

continuous process coil coating line by alkali cleaning, hot water rinsing, application of chemical conversion coating, cold water rinsing, sealing with an acid rinse, and thorough drying.

2. Prime coating: a base coat of polyester paint, specifically formulated to interact with the top-coat, shall be applied to the prepared surfaces by roll coating to a dry film thickness of 0.20 ± 0.05 mils. This prime coat shall be oven cured prior to application of finish coat.
3. Exterior coating: a finish coating (see above) shall be applied over the primer by roll coating to a dry film thickness of 0.80 ± 0.05 mils (3.80 ± 0.05 mils for vinyl plastisol) for a total dry film thickness of 1.00 ± 0.10 mils (4.00 ± 0.10 mils for vinyl plastisol). This finish coating shall be oven-cured.
4. Interior coating: a washcoat shall be applied on the reverse side over the polyester primer by roll coating to a dry film thickness of 0.30 ± 0.05 mils for a total dry film thickness of 0.50 ± 0.10 mils. The washcoat shall be oven-cured.
5. Color: the color of the exterior finish shall be _____ as chosen from the manufacturer's standard color chart.
6. Physical properties: the coating shall conform to the manufacturer's standard performance criteria as listed by certified test reports for fade, chalk, abrasion, humidity, adhesion, pollution resistance, and others as required and standard within the industry.

2.04 ACCESSORIES

- A. Flashing and Trim
 1. All flashing and trim shall be of the same material, gauge, finish, and color as the roof panels and fabricated in accordance with standard SMACNA procedure and details.
 2. Fabricate gutters and downspouts in the same gauge, material, finish, and color as the roof panels.
- B. Fasteners
 1. All screws shall be aluminum, plated steel, or stainless steel. They shall have a combination steel and EPDM washer.
 2. Screws for panel to girt/purlins shall be of the type and size _____ and of sufficient length to penetrate the supporting member by 1". All fasteners shall be applied in accordance with the fastening schedule for Deep Rib IV.
 3. Screws for flashings and sidelaps shall be #14 HHA x 3/4" sheet metal stitch screws. All accessories, flashings, and sidelaps shall be fastened 12" o.c.
- C. Caulking shall be a polyurethane where it is exposed and there is no thermal movement. All caulking or sealing shall be done in a neat manner with excess caulking or sealant removed from exposed surfaces.
- D. Caulking shall be non-skinning, non-hardening gun grade butyl sealant or butyl sealant tape with a minimum thickness of 1/4" where it is concealed and where thermal movement must be accommodated. All caulking or sealing shall be done in a neat manner with excess caulking or sealant removed from exposed surfaces.
- E. Closures shall be pre-molded polyethylene to match the profile of the Deep Rib IV panel and shall be in lengths as supplied by the panel manufacturer.
- F. Vapor Retarder:
 1. Retarder with a permeance of 0.05 or less as determined by ASTM E 98.

2.05 RELATED MATERIALS

- A. Refer to other sections listed in Related Sections paragraph for related materials.

2.06 FABRICATION

- A. Panels are lappable. It is recommended that individual aluminum roof panels not exceed 16' in length and steel roof panels not exceed 32' in length for thermal movement reasons.
- B. Panels shall be roll formed on a stationary industrial type rolling mill to gradually shape the sheet metal. Portable rollformers, rented or owned by the installer, are not acceptable.
- C. Fabricate flashings from the same material as the roof system.

2.07 SOURCE QUALITY

- A. Source Quality: obtain metal panels and accessories from a single manufacturer.
- B. Fabrication tolerances
 1. Rib height: 4" ± 1/4".
 2. Panel shearing length: ± 1/4" maximum.
 3. Follow tolerances in MCA's Preformed Metal Wall Guidelines.
- C. Tests and inspections
- D. Verification of performance

3.01 MANUFACTURER'S INSTRUCTIONS

- A. Compliance: Comply with manufacturer's product data, including product technical bulletins, product catalog installation instructions, and product cartons for installation.

3.02 EXAMINATION

- A. Installer shall:
 1. Inspect purlins, girts, and/or roof deck to verify that they comply with shop drawing layout and are smooth, even, sound, and free of depressions.
 2. Report variations and potential problems in writing to the architect.

3.03 INSTALLATION

- A. Conform to the standard set forth in the SMACNA architectural sheet metal manuals and the approved shop drawings detailed for the project.
- B. Install panels plumb, level, and straight with the ribs parallel, conforming to the design as indicated.
- C. Install panel system so it is watertight, without waves, warps, buckles or distortions, and allow for thermal movement considerations.
- D. Abrasive devices shall not be used to cut on or near roof or wall panel system.
- E. Apply sealant tape or caulking as necessary at flashing and panel joints to prevent water penetration.
- F. Remove any strippable film immediately upon exposure to direct sunlight.
- G. Vapor retarder: The joints, perimeter, and all openings shall be sealed per the manufacturer's instructions to provide a continuous vapor retarder.
- H. Underlayment (solid substrate):
 1. Provide one layer of 30# felt with horizontal overlaps and endlaps staggered between layers.
 2. Provide ice and water shield membrane at all valley and eave conditions as well as any area at less than a 3:12 slope.
 3. Lay parallel to ridge line with 2 1/2" horizontal laps and 6" vertical laps

3.04 CLEANING

- A. Dispose of excess materials and debris from jobsite.
- B. Remove filings, grease, stains, marks, or excess sealants from roof panel system to prevent staining.
- C. Protect work from damage from other trades until final acceptance.

- * Kynar® 500 is a registered trademark of Elf Atochem North America, Inc.
Hylar® 5000 is a registered trademark of Ausimont USA, Inc.